


**MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE
SPECIFICATIONS FOR UNDERGROUND PEDESTAL
INSTALLATION FOR MOBILE HOMES**

Disconnect	Copper Wire	Aluminum Wire	Conduit Size
100 Amp	#2	#2	2 1/4"
200 Amp	3/0	4/0	2 1/2"
Equipment Ground	#4 bare	#4 bare	2 1/4"

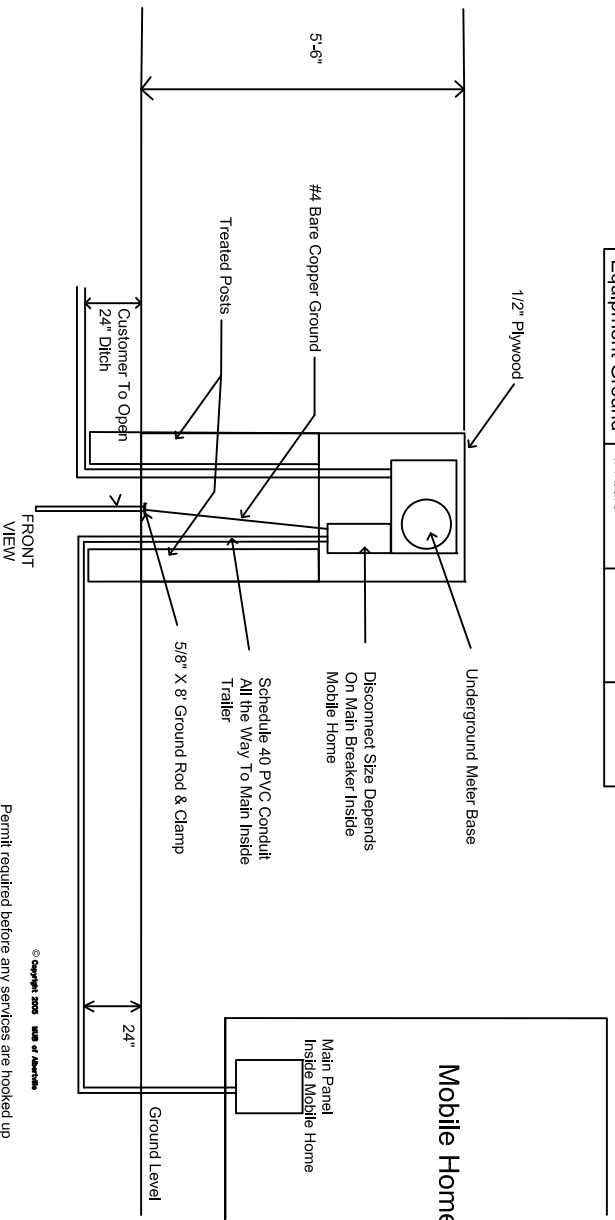

© Copyright 2005 City of Albertville
Permit required before any services are hooked up

- Do not allow any type of meter base to be mounted on the side of the mobile home
- An outside disconnect adjacent to the meter base rated for main breaker inside mobile home
- Is the pedestal set so that the underground service is in a straight line from the pole and does not go underneath any part of the mobile home?
- The meter base and disconnect should be mounted on the pressure treated material
- The meter and disconnect should be mounted with two-inch lag bolts
- The wires in conduit at all points are above the ground
- ** Do not use shielded entrance cable in conduit (Gray Insulation)
- Is the wire approved for underground service?
- ** Do not use shielded entrance cable for direct burial

Note #1 Meter base/Disconnect can not be mounted on the side of mobile home
 Note #2 Customer must provide space for the installation of conduit in left hand side of meter base
 Note #3 Shielded entrance cable (Gray Insulation) can not be used with conduit and can not be direct buried