


MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE
SPECIFICATIONS FOR TYPICAL COMMERCIAL PADMOUNT INSTALLATION
(Not to Scale)

- Meter socket installed at 5'-6"
- Ground rods - 5/8" x 8'
- 2 ground rods - one installed in both the primary and secondary side
- Ground wire should be continuous length up to meter base
- Ground wire #4 Bare Copper
- Use Penetrox or Oxyguard on all connections
- All customer provided material should be designed to NEC specifics
- Secondary Conduit - 2.5" minimum diameter

- Call the office for pre-construction and inspection before closing ditch
(256)-878-3761

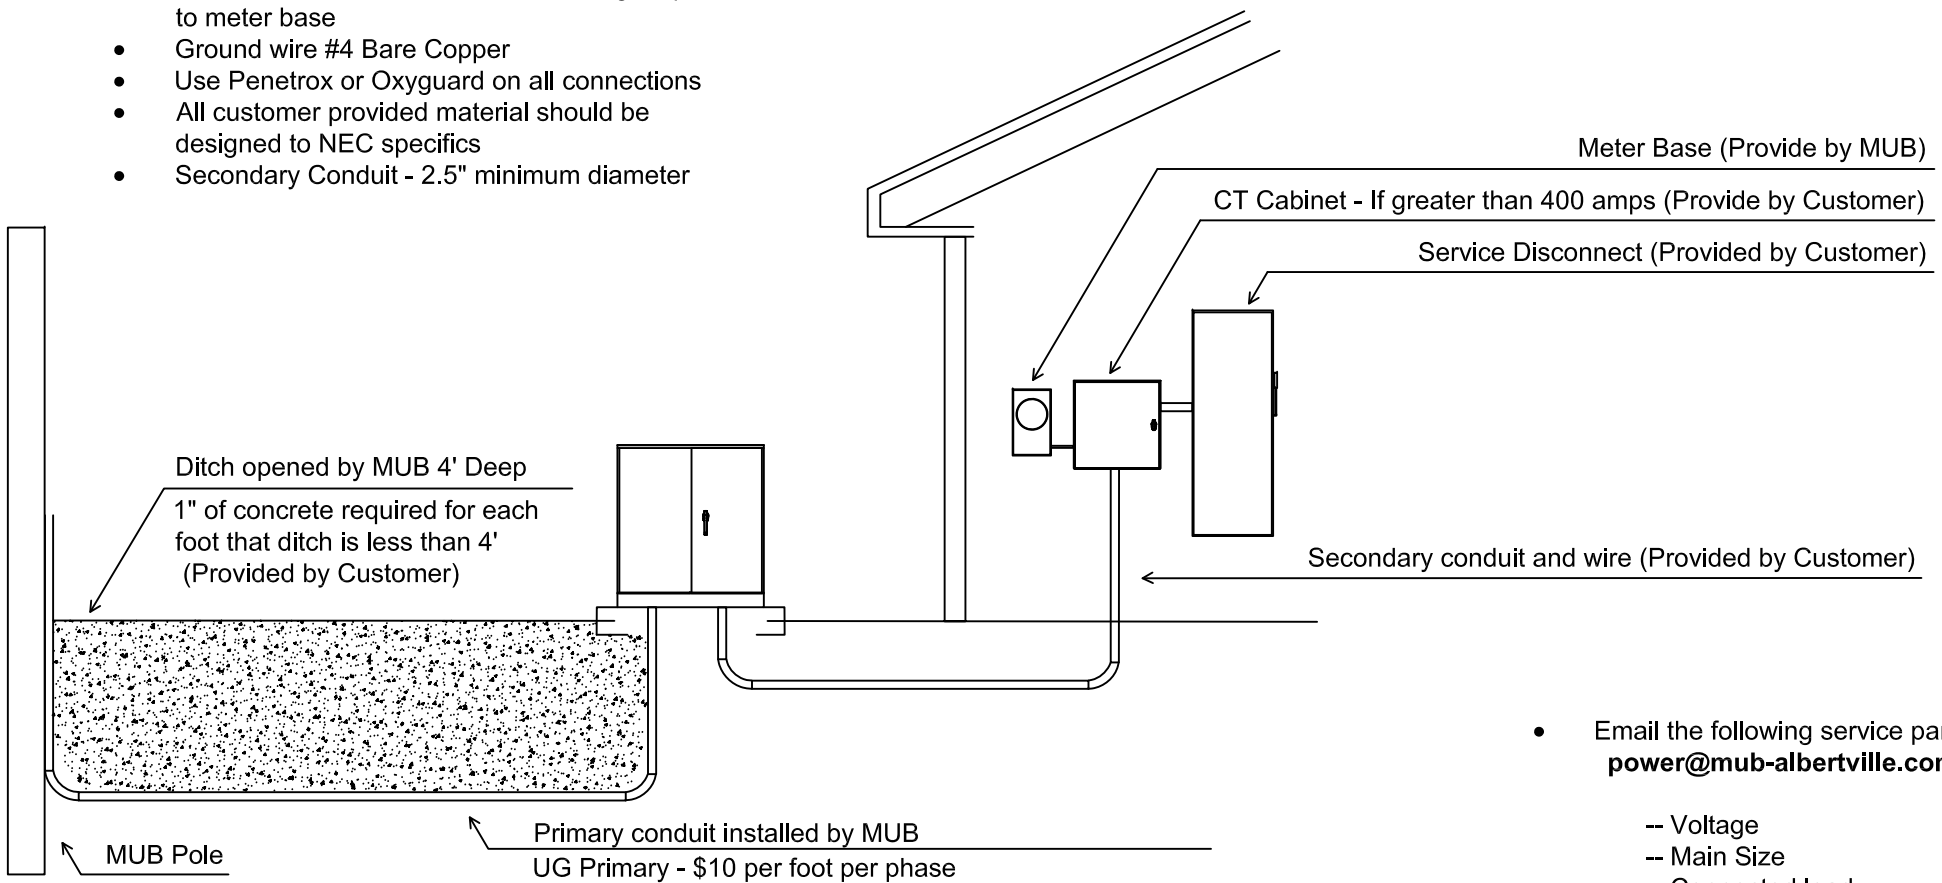

- Email the following service parameters to **power@mub-albertville.com**
 - Voltage
 - Main Size
 - Connected load