


MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE  
SPECIFICATIONS FOR TYPICAL COMMERCIAL INSTALLATION  
(Not to Scale)

- Meter socket installed at 5'-6"
- Ground rods - 5/8" x 8'
- Ground wire should be continuous length up to meter base
- Ground wire #4 Bare Copper
- Use Penetrox or Oxyguard on all connections
- All customer provided material should be designed to NEC specifics
- Secondary Conduit - 2.5" minimum diameter

- Call the office for pre-construction and inspection before closing ditch  
(256)-878-3761

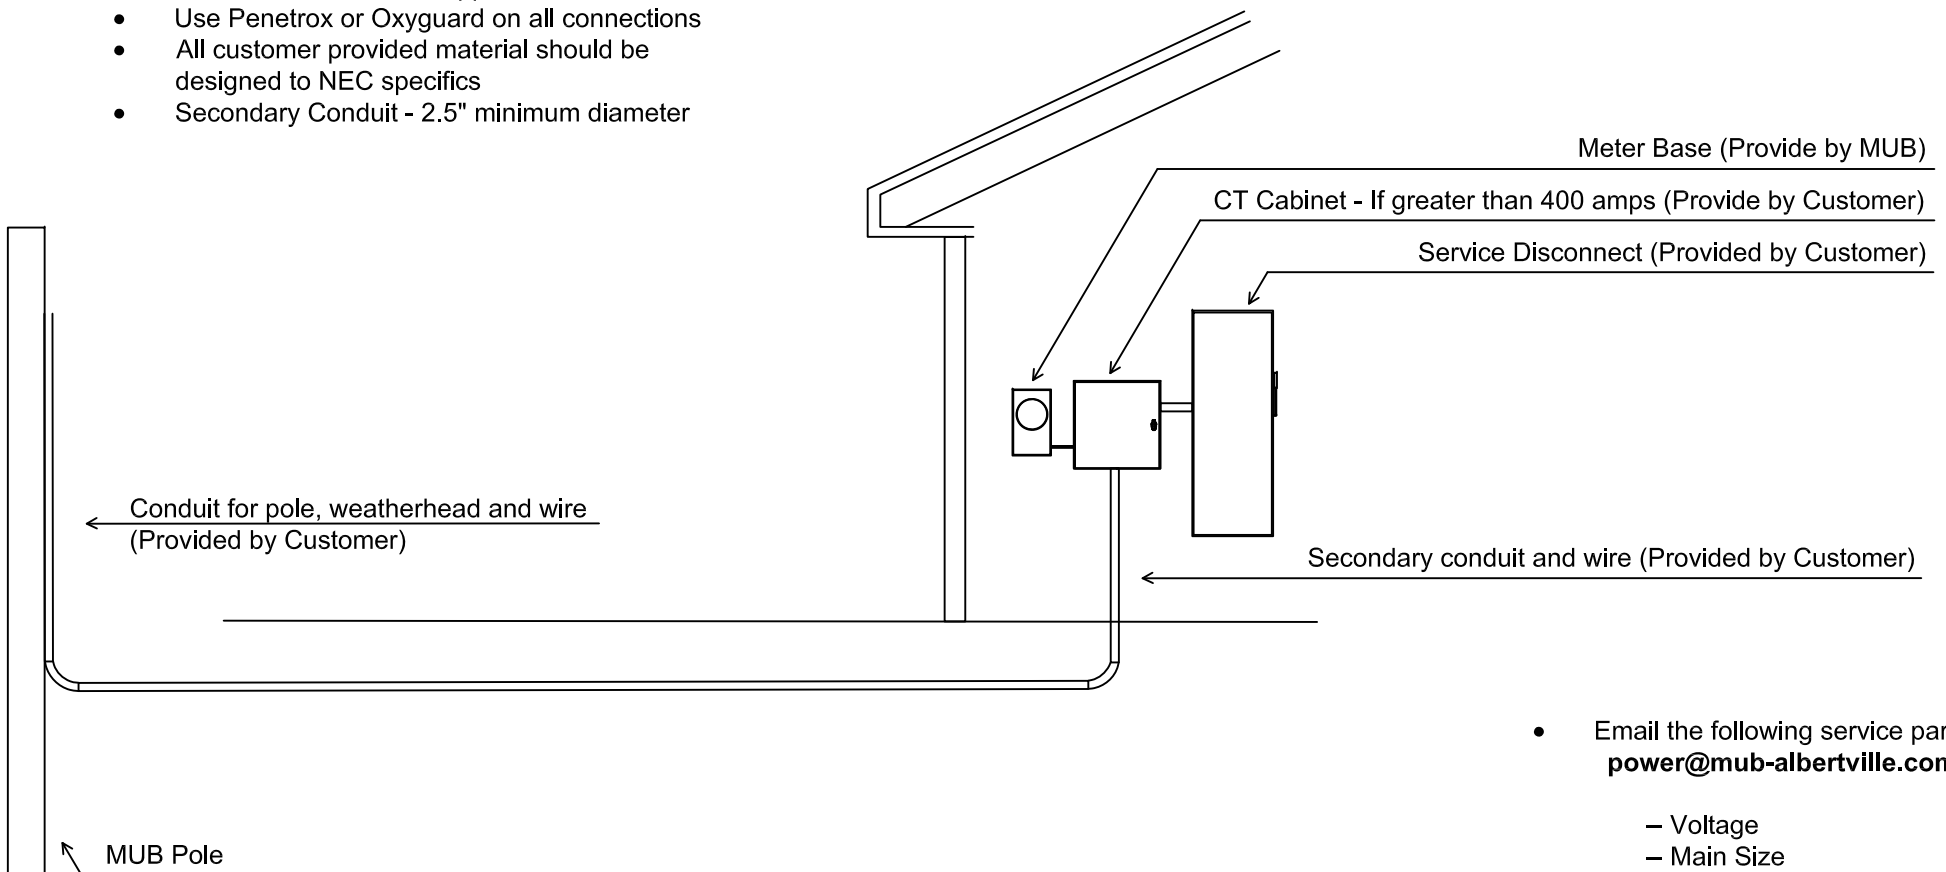

- Email the following service parameters to **power@mub-albertville.com**
  - Voltage
  - Main Size
  - Connected load