


MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE
 SPECIFICATIONS FOR 200 AMP TYPICAL SERVICE MAST INSTALLATION

- Does the conduit for the service extend at least 3ft. above the roof?
- Galvanized Conduit
- If the conduit does not extend above the roof, has an eyebolt been installed through a framing member?
- Is the meter base installed so that the wires to the weather head do not cross the roof?
- Is the meter base installed at the correct height?
- Use Penetrox or Oxyguard on all aluminum connections

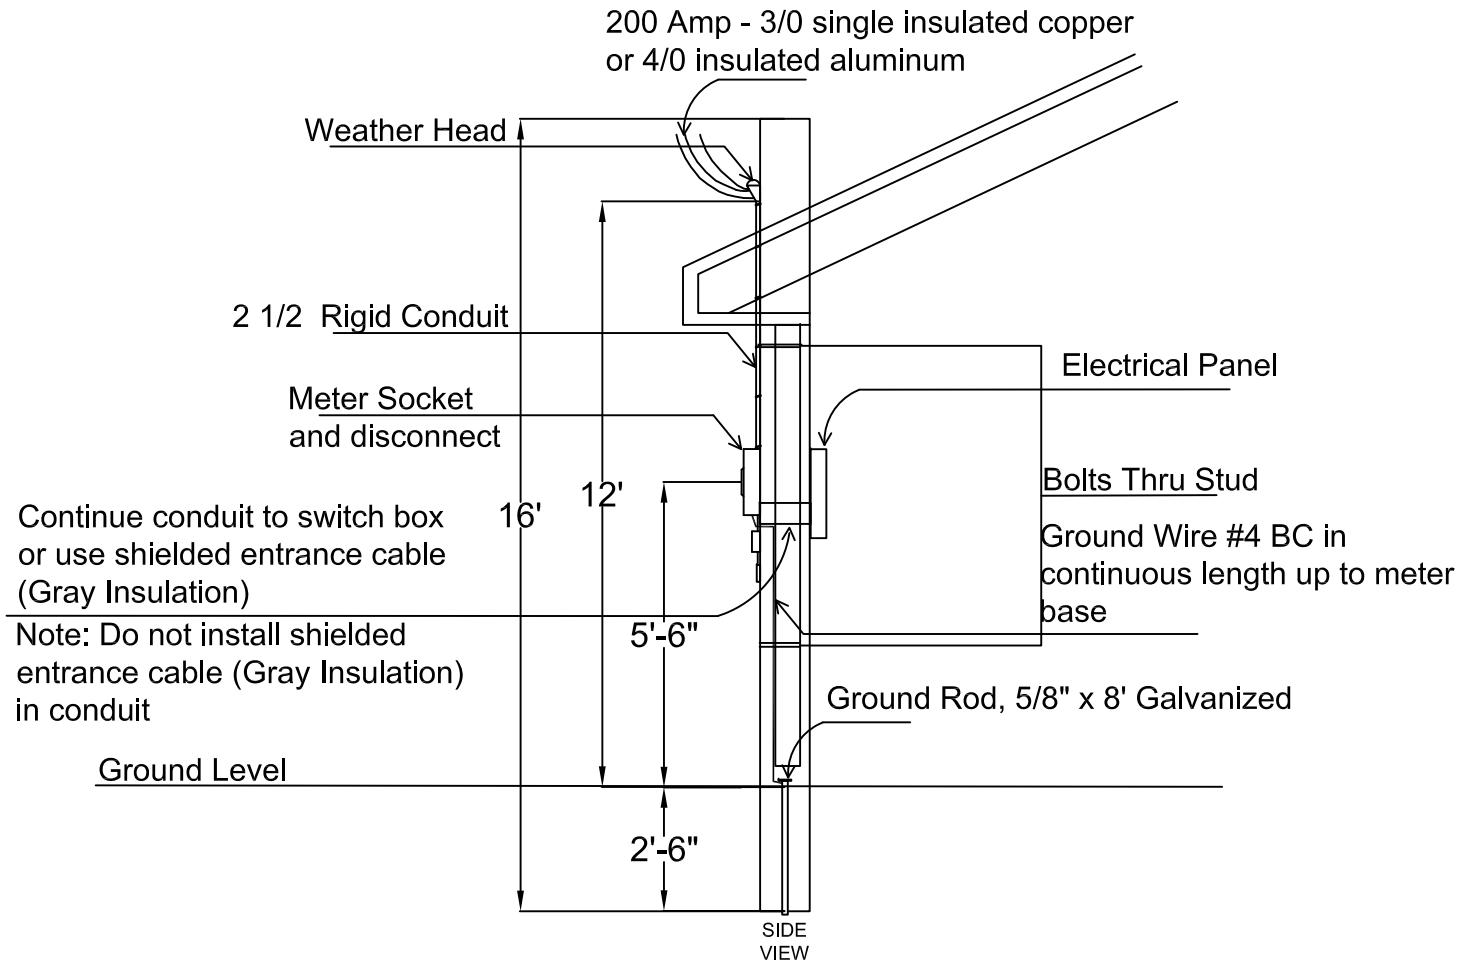

Permit required before any services are hooked up