

MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE
 SPECIFICATIONS FOR RESIDENTIAL OVERHEAD SERVICE
 REQUIREMENTS 200 AMP


Note #1: Use Penetrox On All Aluminum Connections

Note #2: Do not Install Shielded Entrance Cable in Conduit (Gray Insulation)

Note #3: Inside the city limits, must have a disconnect

Note #4: Outside the city limits, must have a disconnect, if Meter Base and Panel are Not Back to Back

Disconnect	Copper Wire	Aluminum Wire	Conduit Size
100 Amp	#2	#2	2 1/2"
200 Amp	3/0	4/0	2 1/2"
Neutral	1/2 Size of Hotleg	1/2 Size of Hotleg	
Ground	#4 Bare Copper		

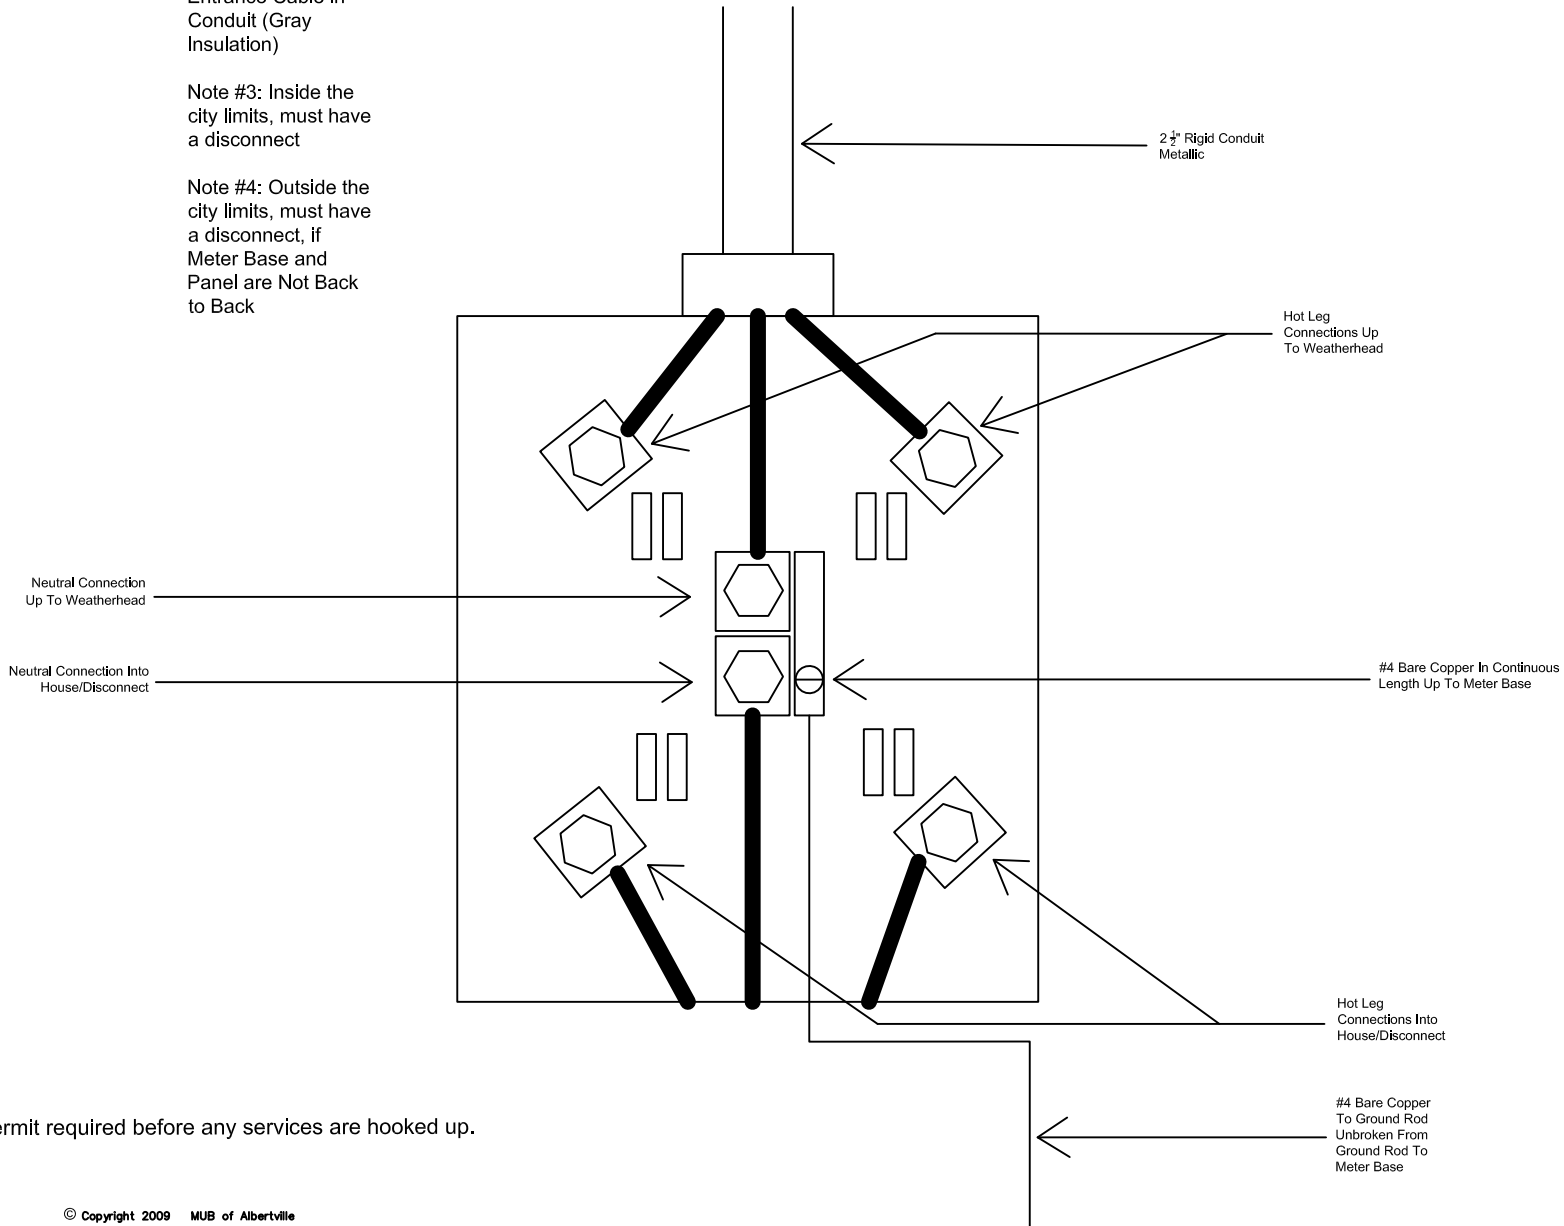

Permit required before any services are hooked up.