


MUNICIPAL UTILITIES BOARD SPECIFICATIONS FOR 100/200 AMP TEMPORARY POLE INSTALLATION

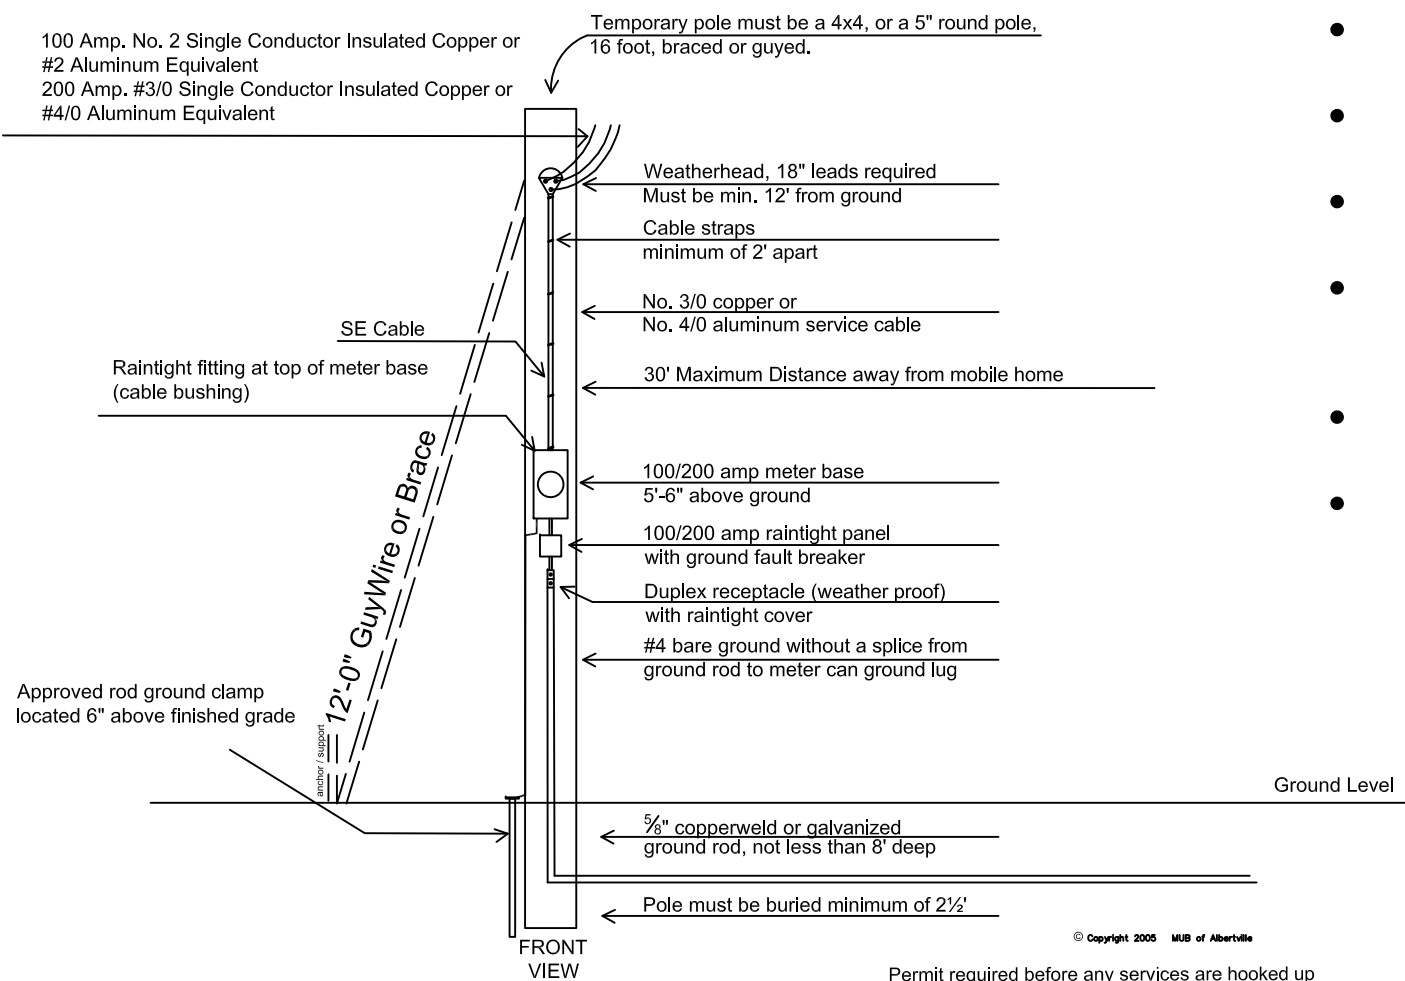

- Is the pole at least 16 Feet tall and at least 5 inches in diameter?
- Or is the pole 16 feet and at least 4x4 pressure treated?
- Is the pole set at least 30 inches into the ground?
- Is the receptacle a ground fault interrupt type, or is it fed by a ground fault interrupt breaker?
- Are the wires from the receptacle to the disconnect run in conduit?
- Is the pole braced properly?

Permit required before any services are hooked up