


MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE
 SPECIFICATIONS FOR RESIDENTIAL UNDERGROUND
 SERVICE REQUIREMENTS 200/400 AMP

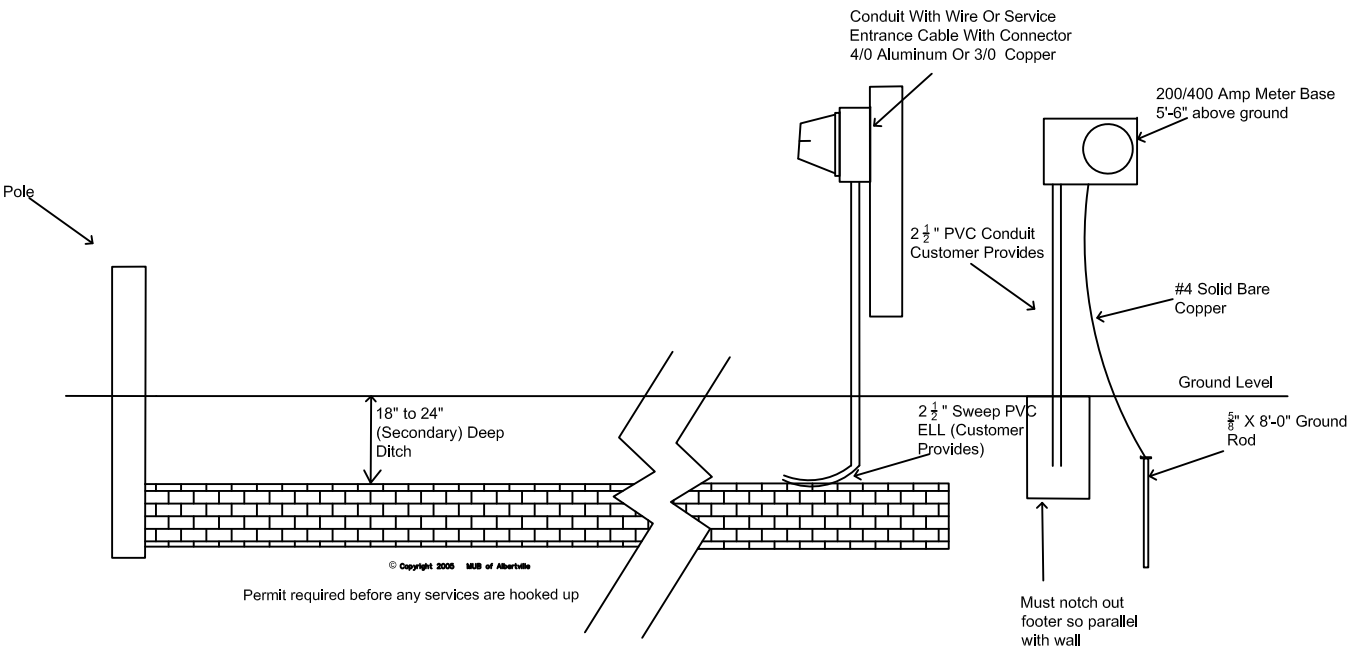

- Must Get Permit From City Hall And Turn Into MUB To Get Meter Base
- Have portions of the Foundation Beyond The Exterior Wall Removed
- Customer Must Open Ditch 18"-24" Inches In Depth
- Clear Ditch of All Obstructions: Tree Roots, Etc.
- Inside the city limits - Must Have Disconnect
- Outside the city limits - Must Have Disconnect, If Meter Base And Main Are Not Back To Back
- All Under Ground Fees Deposits And Permits Must Be Cleared Before MUB Will Turn Services On
- All Undergrounds exceeding 150 ft Will Be Charged Extra Per Ft. With Final Amount Determined By Amount Of Pipe Used
- No Services Mounted On MUB Poles Without Prior Approval By MUB In Extenuating Circumstances