


MUNICIPAL UTILITIES BOARD OF THE CITY OF ALBERTVILLE  
 SPECIFICATIONS FOR UNDERGROUND PEDESTAL  
 INSTALLATION FOR MOBILE HOMES

Disconnect	Copper Wire	Aluminum Wire	Conduit Size
100 Amp	#2	#2	2 1/2"
200 Amp	3/0	4/0	2 1/2"
Equipment Ground	#4 bare	#4 bare	

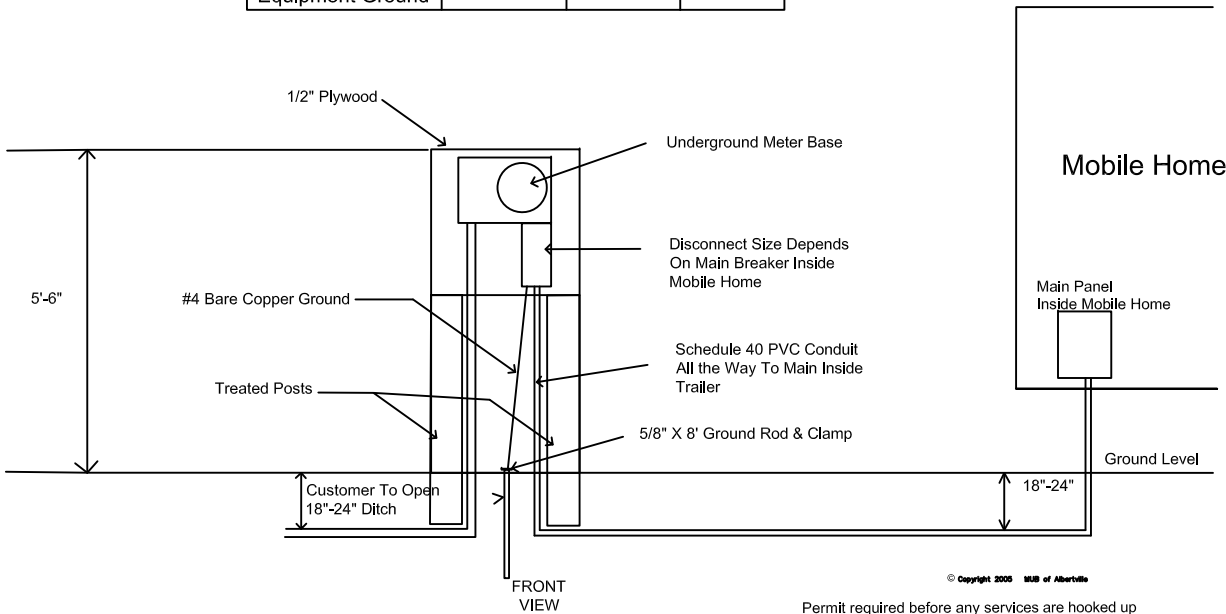

© Copyright 2005 MUB of Albertville

Permit required before any services are hooked up

- Do not allow any type of meter base to be mounted on the side of the mobile home
- An outside disconnect adjacent to the meter base rated for main breaker inside mobile home
- Is the pedestal set so that the underground service is in a straight line from the pole and does not go underneath any part of the mobile home?
- The meter base and disconnect should be mounted on the pressure treated material
- The meter and disconnect should be mounted with two-inch lag bolts
- The wires in conduit at all points are above the ground
- \*\* Do not use shielded entrance cable in conduit (Gray Insulation)
- Is the wire approved for underground service?
- \*\* Do not use shielded entrance cable for direct burial

Note #1 Meter base/Disconnect can not be mounted on the side of mobile home

Note #2 Customer must provide space for the installation of conduit in left hand side of meter base

Note #3 Shielded entrance cable (Gray Insulation) can not be used with conduit and can not be direct buried